

**SUMMARY REPORT
159 IRIS LANE (FORMERLY 1106 IRIS LANE)
LAUREL BAY MILITARY HOUSING AREA
MARINE CORPS AIR STATION BEAUFORT
BEAUFORT, SC**

**Revision: 0
Prepared for:**

**Department of the Navy
Naval Facilities Engineering Command, Mid-Atlantic
9324 Virginia Avenue
Norfolk, Virginia 23511-3095**

and



**Naval Facilities Engineering Command Atlantic
9324 Virginia Avenue
Norfolk, Virginia 23511-3095**

JUNE 2021

**SUMMARY REPORT
159 IRIS LANE (FORMERLY 1106 IRIS LANE)
LAUREL BAY MILITARY HOUSING AREA
MARINE CORPS AIR STATION BEAUFORT
BEAUFORT, SC**

**Revision: 0
Prepared for:**

**Department of the Navy
Naval Facilities Engineering Command, Mid- Atlantic
9324 Virginia Avenue
Norfolk, Virginia 23511-3095**

and



Naval Facilities Engineering Command Atlantic

**9324 Virginia Avenue
Norfolk, Virginia 23511-3095**

Prepared by:



**CDM - AECOM Multimedia Joint Venture
10560 Arrowhead Drive, Suite 500
Fairfax, Virginia 22030**

**Contract Number: N62470-14-D-9016
CTO WE52
JUNE 2021**

Table of Contents

1.0	INTRODUCTION	1
1.1	BACKGROUND INFORMATION.....	1
1.2	UST REMOVAL AND ASSESSMENT PROCESS.....	2
2.0	SAMPLING ACTIVITIES AND RESULTS	3
2.1	UST REMOVAL AND SOIL SAMPLING	3
2.2	SOIL ANALYTICAL RESULTS.....	4
2.3	GROUNDWATER SAMPLING.....	4
2.4	GROUNDWATER ANALYTICAL RESULTS	5
3.0	PROPERTY STATUS.....	5
4.0	REFERENCES	5

Tables

Table 1	Laboratory Analytical Results - Soil
Table 2	Laboratory Analytical Results - Groundwater

Appendices

Appendix A	Multi-Media Selection Process for LBMH
Appendix B	UST Assessment Report
Appendix C	Laboratory Analytical Report - Groundwater
Appendix D	Regulatory Correspondence

List of Acronyms

bgs	below ground surface
BTEX	benzene, toluene, ethylbenzene, and xylenes
CTO	Contract Task Order
COPC	constituents of potential concern
ft	feet
IDIQ	Indefinite Delivery, Indefinite Quantity
IGWA	Initial Groundwater Assessment
JV	Joint Venture
LBMH	Laurel Bay Military Housing
MCAS	Marine Corps Air Station
NAVFAC Mid-Lant	Naval Facilities Engineering Command Mid-Atlantic
NFA	No Further Action
PAH	polynuclear aromatic hydrocarbon
QAPP	Quality Assurance Program Plan
RBSL	risk-based screening level
SCDHEC	South Carolina Department of Health and Environmental Control
Site	LBMH area at MCAS Beaufort, South Carolina
UST	underground storage tank
VISL	vapor intrusion screening level

1.0 INTRODUCTION

The CDM - AECOM Multimedia Joint Venture (JV) was contracted by the Naval Facilities Engineering Command, Mid-Atlantic (NAVFAC Mid-Lant) to provide reporting services for the heating oil underground storage tanks (USTs) located in Laurel Bay Military Housing (LBMH) area at the Marine Corps Air Station (MCAS) Beaufort, South Carolina (Site). This work has been awarded under Contract Task Order (CTO) WE52 of the Indefinite Delivery, Indefinite Quantity (IDIQ) Multimedia Environmental Compliance Contract (Contract No. N62470-14-D-9016).

As of January 2014, the LBMH addresses were re-numbered to comply with the E-911 emergency response addressing system; however, in order to remain consistent with historical sampling and reporting for LBMH area, the residences will continue to be referenced with their original address numbers in sample nomenclature and reporting documents.

This report summarizes the results the environmental investigation activities associated with the storage of home heating oil and the potential release of petroleum constituents at the referenced property. Based on the results of the investigation, a No Further Action (NFA) determination has been made by the South Carolina Department of Health and Environmental Control (SCDHEC) for 159 Iris Lane (Formerly 1106 Iris Lane). This NFA determination indicates that there are no unacceptable risks to human health or the environment for the petroleum constituents associated with the home heating oil USTs. The following information is included in this report:

- Background information;
- Sampling activities and results; and
- A determination of the property status.

1.1 Background Information

The LBMH area is located approximately 3.5 miles west of MCAS Beaufort. The area is approximately 970 acres in size and serves as an enlisted and officer family housing area. The area is configured with single family and duplex residential structures, and includes recreation, open space, and community facilities. The community includes approximately 1,300 housing units, including legacy Capehart style homes and newer duplex style homes. The housing area

is bordered on the west by salt marshes and the Broad River, and to the north, east and south by uplands. Forested areas lie along the northern and northeastern borders.

Capehart style homes within the LBMH area were formerly heated using heating oil stored in USTs at each residence. There were 1,100 Capehart style housing units in the LBMH area. The newer duplex homes within the LBMH area never utilized heating oil tanks. Heating oil has not been used at Laurel Bay since the mid-1980s. As was the accepted practice at the time, USTs were drained, filled with dirt, capped, and left in place when they were removed from service. Residential USTs are not regulated in the State of South Carolina (i.e., there are no federal or state laws governing installation, management, or removal).

In 2007, MCAS Beaufort began a voluntary program to remove the unregulated, residential USTs and conduct sampling activities to determine if, and to what extent, petroleum constituents may have impacted the surrounding environment. MCAS Beaufort coordinated with SCDHEC to develop removal procedures that were consistent with procedural requirements for regulated USTs. All tank removal activities and follow-on actions are conducted in coordination with SCDHEC. To date, all known USTs have been removed from all residential properties within the LBMH area.

1.2 UST Removal and Assessment Process

During the UST removal process, a soil sample was collected from beneath the UST excavations (approximately 4 to 6 feet [ft] below ground surface [bgs]) and analyzed for a predetermined list of constituents of potential concern (COPCs) associated with the petroleum compounds found in home heating oil. These COPCs, derived from the *Quality Assurance Program Plan (QAPP) for the Underground Storage Tank Management Division, Revision 3.1* (SCDHEC, 2016) and the *Underground Storage Tank Assessment Instructions for Permanent Closure and Change-In-Service*, (SCDHEC, 2018), are as follows:

- benzene, toluene, ethylbenzene, and xylenes (BTEX),
- naphthalene, and
- five select polynuclear aromatic hydrocarbon (PAHs): benzo(a)anthracene, benzo(b)fluoranthene, benzo(k)fluoranthene, chrysene and dibenz(a,h)anthracene.

Soil sample results were submitted by MCAS Beaufort to SCDHEC utilizing SCDHEC's UST Assessment Report form. In accordance with SCDHEC's *QAPP for the UST Management*

Division (SCDHEC, 2016), the soil screening levels consists of SCDHEC risk-based screening levels (RBSLs). It should be noted that the RBSLs for select PAHs were revised in Revision 2.0 of the QAPP (SCDHEC, 2013) and were revised again in Revision 3.0 (SCDHEC, 2015). The screening levels used for evaluation at each site were those levels that were in effect at the time of reporting and review by SCDHEC.

The results of the soil sampling at each former UST location were used to determine if a potential for groundwater contamination exists (i.e., soil results greater than RBSLs) and subsequently to select properties for follow-up initial groundwater assessment (IGWA) sampling. The results of the IGWA sampling (if necessary) are used to determine the presence or absence of the aforementioned COPCs in groundwater and identify whether former UST locations will require additional delineation of COPCs in groundwater. In order to delineate the extent of impact to groundwater, permanent wells are installed and a sampling program is established for those former UST locations where IGWA sampling has indicated the presence of COPCs in excess of the SCDHEC RBSLs for groundwater. Groundwater analytical results are also compared to the site specific groundwater vapor intrusion screening levels (VISLs) to evaluate the potential for vapor intrusion and the necessity for an investigation associated with this media. A multi-media investigation selection process tree, applicable to the LBMH UST investigations, is presented as Appendix A.

2.0 SAMPLING ACTIVITIES AND RESULTS

The following section presents the sampling activities and associated results for 159 Iris Lane (Formerly 1106 Iris Lane). Details regarding the soil investigation at this site are provided in the *SCDHEC UST Assessment Report – 1106 Iris Lane* (MCAS Beaufort, 2008). The UST Assessment Report is provided in Appendix B. Details regarding the IGWA sampling activities at this site are provided in the *Investigation of Ground Water at Leaking Heating Oil UST Sites Report* (Resolution Consultants, 2008). The laboratory report that includes the pertinent IGWA analytical results for this site is presented in Appendix C.

2.1 UST Removal and Soil Sampling

On July 23, 2007, a single 280 gallon heating oil UST was removed from the front of the house at 159 Iris Lane (Formerly 1106 Iris Lane). The former UST location is indicated in the figure of the UST Assessment Report (Appendix B). The UST was removed, cleaned, and shipped offsite for recycling. There was no visual evidence (i.e., staining or sheen) of petroleum impact at the

time of the UST removal. According to the UST Assessment Report (Appendix B), the depth to the base of the UST was 5'6" bgs and a single soil sample was collected from that depth. An additional soil sample was collected from the side of the excavation at a depth of 3'6" bgs. The samples were collected from the fill port side of the former UST to represent a worst case scenario.

Following UST removal, soil samples were collected from the base and the side of the excavation and shipped to an offsite laboratory for analysis of the petroleum COPCs. Sampling was performed in accordance with applicable South Carolina regulation R.61-92, Part 280 (SCDHEC, 2017) and assessment guidelines.

2.2 Soil Analytical Results

A summary of the laboratory analytical results and SCDHEC RBSLs is presented in Table 1. A copy of the laboratory analytical data report is included in the UST Assessment Report presented in Appendix B. The laboratory analytical data report includes the soil results for the additional PAHs that were analyzed, but do not have associated RBSLs.

The soil sample results were submitted by MCAS Beaufort to SCDHEC utilizing SCDHEC's UST Assessment Report form (Appendix B). The results of the soil sampling at the former UST location were used by MCAS Beaufort, in consultation with SCDHEC, to determine a path forward (i.e., additional sampling or NFA) for the property. The soil results collected from 159 Iris Lane (Formerly 1106 Iris Lane) were greater than the SCDHEC RBSLs, which indicated further investigation was required. In a letter dated August 13, 2008, SCDHEC requested an IGWA for 159 Iris Lane (Formerly 1106 Iris Lane) to determine if the groundwater was impacted by petroleum COPCs. SCDHEC's request letter is provided in Appendix D.

2.3 Groundwater Sampling

On July 28, 2008, a temporary monitoring well was installed at 159 Iris Lane (Formerly 1106 Iris Lane), in accordance with the South Carolina Well Standards and Regulations (R.61-71.H-I, updated June 24, 2016). In order to provide data that can be used to determine whether COPCs are migrating to underlying groundwater, the monitoring well was placed in the same general location as the former heating oil UST. The former UST location is indicated in the figure of the UST Assessment Report (Appendix B). Further details are provided in the *Investigation of Ground Water at Leaking Heating Oil UST Sites Report* (Resolution Consultants, 2008).

The sampling strategy for this phase of the investigation required a one-time sampling event of the temporarily installed monitoring well. Following well installation and development, groundwater samples were collected using low-flow methods and shipped to an offsite laboratory for analysis of the petroleum COPCs. Upon completion of groundwater sampling, the temporary well was abandoned in accordance with the South Carolina Well Standards and Regulations R.61-71 (SCDHEC, 2016).

2.4 Groundwater Analytical Results

A summary of the laboratory analytical results and SCDHEC RBSLs is presented in Table 2. A copy of the laboratory analytical data report is included in Appendix C.

The groundwater results collected from 159 Iris Lane (Formerly 1106 Iris Lane) were less than the SCDHEC RBSLs and the site specific groundwater VISLs (Table 2), which indicated that the groundwater was not impacted by COPCs associated with the former UST at concentrations that present a potential risk to human health and the environment. Field forms are provided in the *Investigation of Ground Water at Leaking Heating Oil UST Sites Report* (Resolution Consultants, 2008).

3.0 PROPERTY STATUS

Based on the analytical results for groundwater, SCDHEC made the determination that NFA was required for 159 Iris Lane (Formerly 1106 Iris Lane). This NFA determination was obtained in a letter dated December 18, 2008. SCDHEC's NFA letter is provided in Appendix D.

4.0 REFERENCES

Marine Corps Air Station Beaufort, 2008. *South Carolina Department of Health and Environmental Control (SCDHEC) Underground Storage Tank Assessment Report – 1106 Iris Lane, Laurel Bay Military Housing Area*, January 2008.

Resolution Consultants, 2008. *Investigation of Ground Water at Leaking Heating Oil UST Sites Report for Laurel Bay Military Housing Area, Multiple Properties, Laurel Bay Military Housing Area, Marine Corps Air Station Beaufort, Beaufort, South Carolina*, November 2008.

South Carolina Department of Health and Environmental Control Bureau of Land and Waste Management, 2013. *Quality Assurance Program Plan for the Underground Storage Tank Management Division, Revision 2.0*, April 2013.

South Carolina Department of Health and Environmental Control Bureau of Land and Waste Management, 2015. *Quality Assurance Program Plan for the Underground Storage Tank Management Division, Revision 3.0*, May 2015.

South Carolina Department of Health and Environmental Control Bureau of Land and Waste Management, 2016. *Quality Assurance Program Plan for the Underground Storage Tank Management Division, Revision 3.1*, February 2016.

South Carolina Department of Health and Environmental Control Bureau of Land and Waste Management, 2017. *R.61-92, Part 280, Underground Storage Tank Control Regulations*, March 2017.

South Carolina Department of Health and Environmental Control Bureau of Land and Waste Management, 2018. *Underground Storage Tank Assessment Instructions for Permanent Closure and Change-In-Service*, March 2018.

South Carolina Department of Health and Environmental Control Bureau of Water, 2016. *R.61-71, Well Standards*, June 2016.

Tables

Table 1
Laboratory Analytical Results - Soil
159 Iris Lane (Formerly 1106 Iris Lane)
Laurel Bay Military Housing Area
Marine Corps Air Station Beaufort
Beaufort, South Carolina

Constituent	SCDHEC RBSLs ⁽¹⁾	Results Samples Collected 07/23/07	
		1106 Iris Bottom 01	1106 Iris Side 02
Volatile Organic Compounds Analyzed by EPA Method 8260B (mg/kg)			
Benzene	0.003	ND	ND
Ethylbenzene	1.15	0.0265	0.00522
Naphthalene	0.036	0.484	0.212
Toluene	0.627	ND	ND
Xylenes, Total	13.01	0.0335	0.00276
Semivolatile Organic Compounds Analyzed by EPA Method 8270D (mg/kg)			
Benzo(a)anthracene	0.66	0.0283	0.303
Benzo(b)fluoranthene	0.66	ND	0.234
Benzo(k)fluoranthene	0.66	ND	0.108
Chrysene	0.66	0.0317	0.366
Dibenz(a,h)anthracene	0.66	ND	ND

Notes:

⁽¹⁾ South Carolina Risk-Based Screening Levels from the Quality Assurance Program Plan for the Underground Storage Tank Management Division, Revision 1.0 and 1.1 (SCDHEC, May 2001 and SCDHEC, February 2011) and the Underground Storage Tank Assessment Guidelines (SCDHEC, February 2006).

Bold font indicates the analyte was detected.

Bold font and shading indicates the concentration exceeds the SCDHEC RBSL.

EPA - United States Environmental Protection Agency

mg/kg - milligrams per kilogram

ND - not detected at the reporting limit (or method detection limit if shown on the laboratory report). The soil laboratory report is provided in Appendix B.

RBSL - Risk-Based Screening Level

SCDHEC - South Carolina Department Of Health and Environmental Control

Table 2
Laboratory Analytical Results - Groundwater
159 Iris Lane (Formerly 1106 Iris Lane)
Laurel Bay Military Housing Area
Marine Corps Air Station Beaufort
Beaufort, South Carolina

Constituent	SCDHEC RBSLs ⁽¹⁾	Site-Specific Groundwater VISLs (µg/L) ⁽²⁾	Results Sample Collected 07/28/08	
			1106 Iris A	1106 Iris D
Volatile Organic Compounds Analyzed by EPA Method 8260B (µg/L)				
Benzene	5	16.24	ND	ND
Ethylbenzene	700	45.95	ND	ND
Naphthalene	25	29.33	ND	ND
Toluene	1000	105,445	ND	ND
Xylenes, Total	10,000	2,133	ND	ND
Semivolatile Organic Compounds Analyzed by EPA Method 8270D (µg/L)				
Benzo(a)anthracene	10	NA	ND	ND
Benzo(b)fluoranthene	10	NA	ND	ND
Benzo(k)fluoranthene	10	NA	ND	ND
Chrysene	10	NA	ND	ND
Dibenz(a,h)anthracene	10	NA	ND	ND

Notes:

⁽¹⁾ South Carolina Risk-Based Screening Levels from the Quality Assurance Program Plan for the Underground Storage Tank Management Division, Revision 3.1 (SCDHEC, February 2016).

⁽²⁾ Site-specific groundwater VISLs were calculated using the EPA JE Model Spreadsheets (Version 3.1, February 2004) and conservative modeling inputs representative of a small single-story house with an 8 foot ceiling. Site-specific groundwater VISLs were developed based on a target risk level of 1×10^{-6} , a target hazard quotient of 1 (per target organ), and a default residential exposure scenario, assuming exposure for 24 hours/day, 350 days/year, for 26 years. Modeling was performed for a range of depths to groundwater for application as appropriate in different areas of the Laurel Bay Military Housing Area. The most conservative levels are presented for comparison. Refer to Appendix H of the Uniform Federal Policy Sampling Analysis and Sampling Plan for Vapor Media, Revision 4 (Resolution Consultants, April 2017) for additional information.

Bold font indicates the analyte was detected.

Bold font and shading indicates the concentration exceeds the SCDHEC RBSL and/or the Site-Specific Groundwater VISL.

EPA - United States Environmental Protection Agency

JE - Johnson & Ettinger

NA - Not Applicable

ND - not detected at the reporting limit (or method detection limit if shown on the laboratory report). The groundwater laboratory report is provided in Appendix C.

RBSL - Risk-Based Screening Level

SCDHEC - South Carolina Department Of Health and Environmental Control

µg/L - micrograms per liter

VISL - Vapor Intrusion Screening Level

Appendix A
Multi-Media Selection Process for LBMH



Appendix A - Multi-Media Selection Process for LBMH

Appendix B
UST Assessment Report

Attachment 1
South Carolina Department of Health and Environmental Control (SCDHEC)
Underground Storage Tank (UST) Assessment Report

Date Received
State Use Only

Submit Completed Form To:
UST Program
SCDHEC
2600 Bull Street
Columbia, South Carolina 29201
Telephone (803) 896-6240

I. OWNERSHIP OF UST (S)

Beaufort Military Complex Family Housing		
Owner Name (Corporation, Individual, Public Agency, Other)		
1510 Laurel Bay Blvd.		
Mailing Address		
Beaufort	SC	29906
City	State	Zip Code
843	379-3305	Kyle Broadfoot
Area Code	Telephone Number	Contact Person

II. SITE IDENTIFICATION AND LOCATION

N/A		
Permit I.D. #		
Actus LEND LEASE Construction		
Facility Name or Company Site Identifier		
1510 Laurel Bay Blvd. 1106 Iris Ln.		
Street Address or State Road (as applicable)		
Beaufort, SC	29906	Beaufort
City	ZIP	County

III. INSURANCE INFORMATION

Insurance Statement

The petroleum release reported to DHEC on N/A at Permit ID # may qualify to receive state monies to pay for appropriate site rehabilitation activities. Before participation is allowed in the State Clean-up fund, written confirmation of the existence or non-existence of an environmental insurance policy is required. **This section must be completed.**

Is there now, or has there ever been an insurance policy or other financial mechanism that covers this UST release? **YES** ☐ **NO** ☐ (check one)

If you answered **YES** to the above question, please complete the following information:

My policy provider is: _____
The policy deductible is: _____
The policy limit is: _____

If you have this type of insurance, please include a copy of the policy with this report.

And

I do/do not (circle one) wish to participate in the Superb Program.

IV. CERTIFICATION (To be signed by the UST owner/operator.)

I certify that I have personally examined and am familiar with the information submitted in this and all attached documents; and that based on my inquiry of those individuals responsible for obtaining this information, I believe that the submitted information is true, accurate, and complete.

Name (Type or print.)

Signature

To be completed by Notary Public:

Sworn before me this _____ day of _____, 20____.

(Name)

Notary Public for the state of _____
Please affix State seal if you are commissioned outside South Carolina

V. UST INFORMATION

Tank 1	Tank 2	Tank 3	Tank 4	Tank 5	Tank 6
#2 DIESEL					
350g					
Steel					
66"					
N					
N					
Removed					
7-23-07					
N					
Y					

- A. Product...(ex. Gas, Kerosene).....
- B. Capacity..(ex. 1k, 2k).....(APPROX.)
- C. Age.....
- D. Construction Material..(ex. Steel, FRP).....
- E. Month/Year of Last Use.....
- F. Depth (ft.) To Base of Tank.....
- G. Spill Prevention Equipment Y/N.....
- H. Overfill Prevention Equipment Y/N.....
- I. Method of Closure Removed/Filled.....
- J. Date Tanks Removed/Filled.....
- K. Visible Corrosion or Pitting Y/N.....
- L. Visible Holes Y/N.....

M. Method of disposal for any USTs removed from the ground (attach disposal manifests)

Recycling - Scrap Steel

N. Method of disposal for any liquid petroleum, sludges, or wastewaters removed from the USTs (attach disposal manifests)

TREATMENT FACILITY BROAD LEAST LANDFILL
SOLIDIFICATION + SUBTITLE D LANDFILL

O. If any corrosion, pitting, or holes were observed, describe the location and extent for each UST

TANK WAS HALF FULL OF SAND.

VI. PIPE INFORMATION

- A. Construction Material..(ex. Steel, FRP).....
- B. Distance from UST to Dispenser.....
- C. Number of Dispensers.....
- D. Type of System Pressure or Suction.....
- E. Was Piping Removed from the Ground? Y/N
- F. Visible Corrosion or Pitting Y/N.....
- G. Visible Holes Y/N.....
- H. Age.....

Tank 1	Tank 2	Tank 3	Tank 4	Tank 5	Tank 6
Steel					
N/A					
-0-					
Electrical Pump					
Y					
N					
N					

- I. If any corrosion, pitting, or holes were observed, describe the location and extent for each piping run.

MINOR CORROSION WAS PRESENT ON FILL PIPE +
Vent pipe -

VII. BRIEF SITE DESCRIPTION AND HISTORY

Home Heating Oil TANK - RESIDENTIAL

VIII. SITE CONDITIONS

	Yes	No	Unk
<p>A. Were any petroleum-stained or contaminated soils found in the UST excavation, soil borings, trenches, or monitoring wells?</p> <p>If yes, indicate depth and location on the site map.</p>		X	
<p>B. Were any petroleum odors detected in the excavation, soil borings, trenches, or monitoring wells?</p> <p>If yes, indicate location on site map and describe the odor (strong, mild, etc.)</p>		X	
<p>C. Was water present in the UST excavation, soil borings, or trenches?</p> <p>If yes, how far below land surface (indicate location and depth)?</p>		X	
<p>D. Did contaminated soils remain stockpiled on site after closure?</p> <p>If yes, indicate the stockpile location on the site map.</p> <p>Name of DHEC representative authorizing soil removal:</p>		X	
<p>E. Was a petroleum sheen or free product detected on any excavation or boring waters?</p> <p>If yes, indicate location and thickness.</p>		X	

IX. SAM. INFORMATION

A.

SCDHEC Lab Certification Number

DW: 84009002

B.

Sample #	Location	Sample Type (Soil/Water)	Soil Type (Sand/Clay)	Depth*	Date/Time of Collection	Collected by	OVA #
						ECHIVARRA	
1	BOTTOM	S	MIX	66"	7-23-07 1146	ACHIVARRA	N/D
2	SIDE	S	MIX	42"	1150	ACHIVARRA	N/D
3							
4							
5							
6							
7							
8							
9							
10							
11							
12							
13							
14							
15							
16							
17							
18							
19							
20							

* = Depth Below the Surrounding Land Surface

X.

SAMPLING METHODOLOGY

Provide a detailed description of the methods used to collect and store the samples. Also include the preservative used for each sample. Please use the space provided below.

EPA Method 8260 B Volatile Organic Compounds

- Preservative: 2% Sodium Bisulfate 1EA

EPA Method 8270 Poly Aromatic Hydrocarbons

- No Preservative

One (1) Sidewall And One (1) Bottom
Sample were secured from tank excavation
Samples were stored and shipped in an
insulated cooler w/ ice.

XI. RECEPTORS

	Yes	No
<p>A. Are there any lakes, ponds, streams, or wetlands located within 1000 feet of the UST system?</p> <p>If yes, indicate type of receptor, distance, and direction on site map.</p>		X
<p>B. Are there any public, private, or irrigation water supply wells within 1000 feet of the UST system?</p> <p>If yes, indicate type of well, distance, and direction on site map.</p>		✓
<p>C. Are there any underground structures (e.g., basements) Located within 100 feet of the UST system?</p> <p>If yes, indicate type of structure, distance, and direction on site map.</p>		✓
<p>D. Are there any underground utilities (e.g., telephone, electricity, gas, water, sewer, storm drain) located within 100 feet of the UST system that could potentially come in contact with the contamination?</p> <p>If yes, indicate the type of utility, distance, and direction on the site map.</p>		✓
<p>E. Has contaminated soil been identified at a depth less than 3 feet below land surface in an area that is not capped by asphalt or concrete?</p> <p>If yes, indicate the area of contaminated soil on the site map.</p>		✓

SUMMARY OF ANALYSIS RESULTS

N/A

Enter the soil analytical data for each soil boring for all COC in the table below and on the following page.

CoC	SB-1	SB-2	SB-3	SB-4	SB-5	SB-6	SB-7	SB-8
Benzene								
Toluene								
Ethylbenzene								
Xylenes								
Naphthalene								
Benzo(a)anthracene								
Benzo(b)flouranthene								
Benzo(k)flouranthene								
Chrysene								
Dibenz(a,h)anthracene								
TPH (EPA 3550)								

CoC	SB-9	SB-10	SB-11	SB-12	SB-13	SB-14	SB-15	SB-16
Benzene								
Toluene								
Ethylbenzene								
Xylenes								
Naphthalene								
Benzo(a)anthracene								
Benzo(b)flouranthene								
Benzo(k)flouranthene								
Chrysene								
Dibenz(a,h)anthracene								
TPH (EPA 3550)								

SUMMARY OF ANALYSIS RESULTS (cont'd)

N/A

Enter the ground water analytical data for each sample for all CoC in the table below. If free product is present, indicate the measured thickness to the nearest 0.01 feet.

CoC	RBSL (µg/l)	W-1	W-2	W -3	W -4
Free Product Thickness	None				
Benzene	5				
Toluene	1,000				
Ethylbenzene	700				
Xylenes	10,000				
Total BTEX	N/A				
MTBE	40				
Naphthalene	25				
Benzo(a)anthracene	10				
Benzo(b)flouranthene	10				
Benzo(k)flouranthene	10				
Chrysene	10				
Dibenz(a,h)anthracene	10				
EDB	.05				
1,2-DCA	.05				
Lead	Site specific				

ANALYTICAL RESULTS

You must submit the laboratory report and chain-of-custody form for the samples. These samples must be analyzed by a South Carolina certified laboratory.

(Attach Certified Analytical Results and Chain-of-Custody Here)
(Please see Form #4)

To assist us in using the proper analytical methods,
is this work being conducted for regulatory purposes?
Compliance Monitoring

Client #: 241

Address:

City/State/Zip Code:

Project Manager:**Telephone Number:**

Sampler Name: (Print Name)

Sampler Signature:

Project Name:

Project #:

Site/Location ID:

State

Report To:

Invoice To:

Quote #:

PO#

TAT <input checked="" type="checkbox"/> Standard Rush (surcharges may apply)	Date Needed:	Fax Results:	Y	N	SAMPLE ID	Date Sampled	Time Sampled	G = Grab, C = Composite	Field Filtered	Matrix SL - Sludge DW - Drinking Water GW - Groundwater S - Solid/Solid WW - Wastewater Specify Other	Preservation & # of Containers	Analyze For:	QC Deliverables None <input checked="" type="checkbox"/> Level 2 (Batch QC) Level 3 Level 4 Other:	REMARKS	
					1124 1215 BOTTOM 01	7-24-07	1010	C							
					1124 1215 SIDE 02	7-24-07	11010	C							
					1130 1215 BOTTOM 01	7-24-07	1315	G							
					1130 1215 SIDE 02	7-24-07	1320	C							
					1140 1215 BOTTOM 01	7-25-07	930	G							
					1140 1215 SIDE 02	7-25	930	C							
					1140 1215 BOTTOM 03	7-25	940	G							
					1140 1215 SIDE 04	7-25	940	C							
					1142 1215 BOTTOM 01	7-25	1450	G							
					1142 1215 SIDE 02	7-25	1440	C							

Special Instructions:

LABORATORY COMMENTS:

Init Lab Temp:

Rec Lab Temp.

Custody Seals:	Y	N	N/A
----------------	---	---	-----

Bottles Supplied by Test America: Y N

8623 CS911725
Method of Shipment: Fe dextOTA- (Oxidant)

Relinquished By: Echevarria Date: 9/1/07 Time: 0905 Received By: [Signature]

Relinquished By: <i>[Signature]</i>	Date: <i>8/1/07</i>	Time: <i>1730</i>	Received By: <i>[Signature]</i>
-------------------------------------	---------------------	-------------------	---------------------------------

Relinquished By:	Date:	Time:	Received By:
------------------	-------	-------	--------------

ANALYTICAL TESTING CORPORATION

EPG

2411

Figure 1. The effect of the concentration of the solution on the adsorption of the dye. The concentration of the solution was 0.01, 0.02, 0.03, 0.04, 0.05, 0.06, 0.07, 0.08, 0.09, 0.1, 0.2, 0.3, 0.4, 0.5, 0.6, 0.7, 0.8, 0.9, 1.0, 1.5, 2.0, 3.0, 4.0, 5.0, 6.0, 7.0, 8.0, 9.0, 10.0, 15.0, 20.0, 30.0, 40.0, 50.0, 60.0, 70.0, 80.0, 90.0, 100.0, 150.0, 200.0, 300.0, 400.0, 500.0, 600.0, 700.0, 800.0, 900.0, 1000.0, 1500.0, 2000.0, 3000.0, 4000.0, 5000.0, 6000.0, 7000.0, 8000.0, 9000.0, 10000.0, 15000.0, 20000.0, 30000.0, 40000.0, 50000.0, 60000.0, 70000.0, 80000.0, 90000.0, 100000.0, 150000.0, 200000.0, 300000.0, 400000.0, 500000.0, 600000.0, 700000.0, 800000.0, 900000.0, 1000000.0, 1500000.0, 2000000.0, 3000000.0, 4000000.0, 5000000.0, 6000000.0, 7000000.0, 8000000.0, 9000000.0, 10000000.0, 15000000.0, 20000000.0, 30000000.0, 40000000.0, 50000000.0, 60000000.0, 70000000.0, 80000000.0, 90000000.0, 100000000.0, 150000000.0, 200000000.0, 300000000.0, 400000000.0, 500000000.0, 600000000.0, 700000000.0, 800000000.0, 900000000.0, 1000000000.0, 1500000000.0, 2000000000.0, 3000000000.0, 4000000000.0, 5000000000.0, 6000000000.0, 7000000000.0, 8000000000.0, 9000000000.0, 10000000000.0, 15000000000.0, 20000000000.0, 30000000000.0, 40000000000.0, 50000000000.0, 60000000000.0, 70000000000.0, 80000000000.0, 90000000000.0, 100000000000.0, 150000000000.0, 200000000000.0, 300000000000.0, 400000000000.0, 500000000000.0, 600000000000.0, 700000000000.0, 800000000000.0, 900000000000.0, 1000000000000.0, 1500000000000.0, 2000000000000.0, 3000000000000.0, 4000000000000.0, 5000000000000.0, 6000000000000.0, 7000000000000.0, 8000000000000.0, 9000000000000.0, 10000000000000.0, 15000000000000.0, 20000000000000.0, 30000000000000.0, 40000000000000.0, 50000000000000.0, 60000000000000.0, 70000000000000.0, 80000000000000.0, 90000000000000.0, 100000000000000.0, 150000000000000.0, 200000000000000.0, 300000000000000.0, 400000000000000.0, 500000000000000.0, 600000000000000.0, 700000000000000.0, 800000000000000.0, 900000000000000.0, 1000000000000000.0, 1500000000000000.0, 2000000000000000.0, 3000000000000000.0, 4000000000000000.0, 5000000000000000.0, 6000000000000000.0, 7000000000000000.0, 8000000000000000.0, 9000000000000000.0, 10000000000000000.0, 15000000000000000.0, 20000000000000000.0, 30000000000000000.0, 40000000000000000.0, 50000000000000000.0, 60000000000000000.0, 70000000000000000.0, 80000000000000000.0, 90000000000000000.0, 100000000000000000.0, 150000000000000000.0, 200000000000000000.0, 300000000000000000.0, 400000000000000000.0, 500000000000000000.0, 600000000000000000.0, 700000000000000000.0, 800000000000000000.0, 900000000000000000.0, 1000000000000000000.0, 1500000000000000000.0, 2000000000000000000.0, 3000000000000000000.0, 4000000000000000000.0, 5000000000000000000.0, 6000000000000000000.0, 7000000000000000000.0, 8000000000000000000.0, 9000000000000000000.0, 10000000000000000000.0, 15000000000000000000.0, 20000000000000000000.0, 30000000000000000000.0, 40000000000000000000.0, 50000000000000000000.0, 60000000000000000000.0, 70000000000000000000.0, 80000000000000000000.0, 90000000000000000000.0, 100000000000000000000.0, 150000000000000000000.0, 200000000000000000000.0, 300000000000000000000.0, 400000000000000000000.0, 500000000000000000000.0, 600000000000000000000.0, 700000000000000000000.0, 800000000000000000000.0, 900000000000000000000.0, 1000000000000000000000.0, 1500000000000000000000.0, 2000000000000000000000.0, 3000000000000000000000.0, 4000000000000000000000.0, 5000000000000000000000.0, 6000000000000000000000.0, 7000000000000000000000.0, 8000000000000000000000.0, 9000000000000000000000.0, 10000000000000000000000.0, 15000000000000000000000.0, 20000000000000000000000.0, 30000000000000000000000.0, 40000000000000000000000.0, 50000000000000000000000.0, 60000000000000000000000.0, 70000000000000000000000.0, 80000000000000000000000.0, 90000000000000000000000.0, 100000000000000000000000.0, 150000000000000000000000.0, 200000000000000000000000.0, 300000000000000000000000.0, 400000000000000000000000.0, 500000000000000000000000.0, 600000000000000000000000.0, 700000000000000000000000.0, 800000000000000000000000.0, 900000000000000000000000.0, 10000000

1. *Journal of Management Studies*, 1997, 34, 1, 1-14.

JOHN MAHONEY

Ex:

CHRIS ECHEVARRIA

Chesario

To assist us in using the proper analytical methods,
is this work being conducted for regulatory purposes?
Compliance Monitoring

LAUREL BAY

EP 2362

State:

State:

[illegible]

PO#:

PO#:

[illegible]

2411

Sampler Signature:

PO#:

21
22
23
24
25
26
27
28

2	Time	7.0
---	------	-----

Method of Stirring: _____

Other:

REMARKS

Client: EPG, INC.
PO BOX 1096
MT PLEASANT, SC 29465
Attn: JOHN MAHONEY

Work Order: OQH0044
Project: LAUREL BAY
Project Number: EP2362

Sampled: 07/23/07-07/27/07
Received: 08/02/07

LABORATORY REPORT

Sample ID: 1036 IRIS SIDE 02 - Lab Number: OQH0044-22 - Matrix: Solid/Soil

CAS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
General Chemistry Parameters											
1A	% Solids	93.7	Q	%	0.100	0.100	1	08/03/07 17:20	RRP	EPA 160.3	7H03059
Volatile Organic Compounds by EPA Method 8260B											
1-43-2	Benzene	0.170	U	ug/kg dry	0.170	0.465	1	08/04/07 02:38	JWT	EPA 8260B	7H03050
00-41-4	Ethylbenzene	1.79		ug/kg dry	0.197	0.465	1	08/04/07 02:38	JWT	EPA 8260B	7H03050
1-20-3	Naphthalene	12.2		ug/kg dry	0.257	0.465	1	08/04/07 02:38	JWT	EPA 8260B	7H03050
08-88-3	Toluene	0.402	U	ug/kg dry	0.402	0.465	1	08/04/07 02:38	JWT	EPA 8260B	7H03050
330-20-7	Xylenes, total	5.85		ug/kg dry	0.242	0.465	1	08/04/07 02:38	JWT	EPA 8260B	7H03050
surrogate: 1,2-Dichloroethane-d4 (73-137%)		117 %									
surrogate: 4-Bromofluorobenzene (59-118%)		103 %									
surrogate: Dibromofluoromethane (55-145%)		101 %									
surrogate: Toluene-d8 (80-117%)		101 %									
Polynuclear Aromatic Hydrocarbons by EPA Method 8270											
1-32-9	Acenaphthene	79.0	U	ug/kg dry	79.0	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
18-96-8	Acenaphthylene	104	U	ug/kg dry	104	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
10-12-7	Anthracene	56.8	U	ug/kg dry	56.8	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-55-3	Benzo (a) anthracene	19.3	U	ug/kg dry	19.3	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
15-99-2	Benzo (b) fluoranthene	18.8	U	ug/kg dry	18.8	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
17-08-9	Benzo (k) fluoranthene	18.8	U	ug/kg dry	18.8	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-24-2	Benzo (g,h,i) perylene	18.5	U	ug/kg dry	18.5	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-32-8	Benzo (a) pyrene	21.9	U	ug/kg dry	21.9	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-12-0	1-Methylnaphthalene	89.4	U	ug/kg dry	89.4	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
8-01-9	Chrysene	21.3	U	ug/kg dry	21.3	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-70-3	Dibenz (a,h) anthracene	23.4	U	ug/kg dry	23.4	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
6-44-0	Fluoranthene	25.6	U	ug/kg dry	25.6	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-73-7	Fluorene	69.7	U	ug/kg dry	69.7	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
3-39-5	Indeno (1,2,3-cd) pyrene	23.1	U	ug/kg dry	23.1	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-57-6	2-Methylnaphthalene	76.0	U	ug/kg dry	76.0	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-20-3	Naphthalene	71.5	U	ug/kg dry	71.5	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-01-8	Phenanthrene	42.0	U	ug/kg dry	42.0	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
1-00-0	Pyrene	36.2	U	ug/kg dry	36.2	178	1	08/09/07 01:51	REM	EPA 8270C	7H06005
surrogate: 2-Fluorobiphenyl (24-121%)		7 %	J1								
surrogate: Nitrobenzene-d5 (19-111%)		*	J1,U								
surrogate: Terphenyl-d14 (44-171%)		107 %									

LABORATORY REPORT

Sample ID: 1106 IRIS BOTTOM 01 - Lab Number: OQH0044-23 - Matrix: Solid/Soil

CAS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
General Chemistry Parameters											
	% Solids	87.3	Q	%	0.100	0.100	1	08/07/07 14:10	RRP	EPA 160.3	7H07028
Volatile Organic Compounds by EPA Method 8260B											
1-43-2	Benzene	5.57	RL2,U	ug/kg dry	5.57	15.2	50	08/04/07 15:23	JWT	EPA 8260B	7H03050
00-41-4	Ethylbenzene	26.5		ug/kg dry	6.44	15.2	50	08/04/07 15:23	JWT	EPA 8260B	7H03050

Client: EPG, INC.
PO BOX 1096
MT PLEASANT, SC 29465
Attn: JOHN MAHONEY

Work Order: OQH0044
Project: LAUREL BAY
Project Number: EP2362

Sampled: 07/23/07-07/27/07
Received: 08/02/07

LABORATORY REPORT

Sample ID: 1106 IRIS BOTTOM 01 - Lab Number: OQH0044-23 - Matrix: Solid/Soil

CAS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
Volatile Organic Compounds by EPA Method 8260B - Cont.											
11-20-3	Naphthalene	484		ug/kg dry	8.41	15.2	50	08/04/07 15:23	JWT	EPA 8260B	7H03050
08-88-3	Toluene	13.1	RL2,U	ug/kg dry	13.1	15.2	50	08/04/07 15:23	JWT	EPA 8260B	7H03050
330-20-7	Xylenes, total	33.5		ug/kg dry	7.90	15.2	50	08/04/07 15:23	JWT	EPA 8260B	7H03050
surrogate: 1,2-Dichloroethane-d4 (73-137%)		102 %									
surrogate: 4-Bromofluorobenzene (59-118%)		112 %									
surrogate: Dibromofluoromethane (55-145%)		98 %									
surrogate: Toluene-d8 (80-117%)		98 %									
Polynuclear Aromatic Hydrocarbons by EPA Method 8270											
3-32-9	Acenaphthene	84.8	U	ug/kg dry	84.8	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
08-96-8	Acenaphthylene	112	U	ug/kg dry	112	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
20-12-7	Anthracene	69.1	I	ug/kg dry	61.0	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
5-55-3	Benzo (a) anthracene	28.3	I	ug/kg dry	20.7	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
15-99-2	Benzo (b) fluoranthene	20.1	U	ug/kg dry	20.1	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
17-08-9	Benzo (k) fluoranthene	20.1	U	ug/kg dry	20.1	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
11-24-2	Benzo (g,h,i) perylene	19.9	U	ug/kg dry	19.9	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
1-32-8	Benzo (a) pyrene	23.5	U	ug/kg dry	23.5	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
1-12-0	1-Methylnaphthalene	96.0	U	ug/kg dry	96.0	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
8-01-9	Chrysene	31.7	I	ug/kg dry	22.9	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
1-70-3	Dibenz (a,h) anthracene	25.1	U	ug/kg dry	25.1	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
16-44-0	Fluoranthene	27.5	U	ug/kg dry	27.5	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
-73-7	Fluorene	74.9	U	ug/kg dry	74.9	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
3-39-5	Indeno (1,2,3-cd) pyrene	24.8	U	ug/kg dry	24.8	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
-57-6	2-Methylnaphthalene	81.6	U	ug/kg dry	81.6	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
-20-3	Naphthalene	76.8	U	ug/kg dry	76.8	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
-01-8	Phenanthrene	221		ug/kg dry	45.1	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
9-00-0	Pyrene	72.2	I	ug/kg dry	38.9	191	1	08/09/07 02:13	REM	EPA 8270C	7H06005
surrogate: 2-Fluorobiphenyl (24-121%)		19 %	JI								
surrogate: Nitrobenzene-d5 (19-111%)		9 %	JI								
surrogate: Terphenyl-d14 (44-171%)		67 %									

LABORATORY REPORT

Sample ID: 1106 IRIS SIDE 02 - Lab Number: OQH0044-24 - Matrix: Solid/Soil

AS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
General Chemistry Parameters											
	% Solids	81.0	Q	%	0.100	0.100	1	08/07/07 14:10	RRP	EPA 160.3	7H07028
Volatile Organic Compounds by EPA Method 8260B											
43-2	Benzene	0.119	U	ug/kg dry	0.119	0.324	1	08/04/07 03:12	JWT	EPA 8260B	7H03050
-41-4	Ethylbenzene	5.22		ug/kg dry	0.137	0.324	1	08/04/07 03:12	JWT	EPA 8260B	7H03050
20-3	Naphthalene	212	L	ug/kg dry	0.179	0.324	1	08/04/07 03:12	JWT	EPA 8260B	7H03050
-88-3	Toluene	0.280	U	ug/kg dry	0.280	0.324	1	08/04/07 03:12	JWT	EPA 8260B	7H03050
3-20-7	Xylenes, total	2.76		ug/kg dry	0.168	0.324	1	08/04/07 03:12	JWT	EPA 8260B	7H03050
surrogate: 1,2-Dichloroethane-d4 (73-137%)		125 %									

Client: EPG, INC.
PO BOX 1096
MT PLEASANT, SC 29465
Attn: JOHN MAHONEY

Work Order: OQH0044
Project: LAUREL BAY
Project Number: EP2362

Sampled: 07/23/07-07/27/07
Received: 08/02/07

LABORATORY REPORT


Sample ID: 1106 IRIS SIDE 02 - Lab Number: OQH0044-24 - Matrix: Solid/Soil

CAS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
Volatile Organic Compounds by EPA Method 8260B - Cont.											
	surrogate: 4-Bromofluorobenzene (59-118%)	74 %									
	surrogate: Dibromofluoromethane (55-145%)	104 %									
	surrogate: Toluene-d8 (80-117%)	92 %									
Polynuclear Aromatic Hydrocarbons by EPA Method 8270											
3-32-9	Acenaphthene	870		ug/kg dry	91.4	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
08-96-8	Acenaphthylene	121	U	ug/kg dry	121	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
20-12-7	Anthracene	675		ug/kg dry	65.8	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
5-55-3	Benzo (a) anthracene	303		ug/kg dry	22.3	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
35-99-2	Benzo (b) fluoranthene	234		ug/kg dry	21.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
37-08-9	Benzo (k) fluoranthene	108	I	ug/kg dry	21.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
31-24-2	Benzo (g,h,i) perylene	42.0	I	ug/kg dry	21.4	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
3-32-8	Benzo (a) pyrene	135	I	ug/kg dry	25.4	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
3-12-0	1-Methylnaphthalene	4200		ug/kg dry	104	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
8-01-9	Chrysene	366		ug/kg dry	24.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
1-70-3	Dibenz (a,h) anthracene	27.1	U	ug/kg dry	27.1	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
16-44-0	Fluoranthene	663		ug/kg dry	29.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
1-73-7	Fluorene	1450		ug/kg dry	80.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
3-39-5	Indeno (1,2,3-cd) pyrene	26.7	U	ug/kg dry	26.7	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
-57-6	2-Methylnaphthalene	4640		ug/kg dry	87.9	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
-20-3	Naphthalene	82.8	U	ug/kg dry	82.8	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
-01-8	Phenanthrene	3020		ug/kg dry	48.6	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
9-00-0	Pyrene	754		ug/kg dry	41.9	206	1	08/09/07 02:35	REM	EPA 8270C	7H06005
	surrogate: 2-Fluorobiphenyl (24-121%)	38 %									
	surrogate: Nitrobenzene-d5 (19-111%)	17 %	J1								
	surrogate: Terphenyl-d14 (44-171%)	91 %									

LABORATORY REPORT


Sample ID: 1120 IRIS BOTTOM 01 - Lab Number: OQH0044-25 - Matrix: Solid/Soil

AS #	Analyte	Result	Q	Units	MDL	PQL	Dil Factor	Analyzed Date/Time	By	Method	Batch
General Chemistry Parameters											
	% Solids	83.0	Q	%	0.100	0.100	1	08/07/07 14:10	RRP	EPA 160.3	7H07028
Volatile Organic Compounds by EPA Method 8260B											
43-2	Benzene	0.0789	U	ug/kg dry	0.0789	0.216	1	08/04/07 03:29	JWT	EPA 8260B	7H03050
-41-4	Ethylbenzene	0.522		ug/kg dry	0.0912	0.216	1	08/04/07 03:29	JWT	EPA 8260B	7H03050
20-3	Naphthalene	7.87		ug/kg dry	0.119	0.216	1	08/04/07 03:29	JWT	EPA 8260B	7H03050
-88-3	Toluene	0.272		ug/kg dry	0.186	0.216	1	08/04/07 03:29	JWT	EPA 8260B	7H03050
0-20-7	Xylenes, total	0.884		ug/kg dry	0.112	0.216	1	08/04/07 03:29	JWT	EPA 8260B	7H03050
	surrogate: 1,2-Dichloroethane-d4 (73-137%)	131 %									
	surrogate: 4-Bromofluorobenzene (59-118%)	62 %									
	surrogate: Dibromofluoromethane (55-145%)	108 %									
	surrogate: Toluene-d8 (80-117%)	84 %									
Polynuclear Aromatic Hydrocarbons by EPA Method 8270											

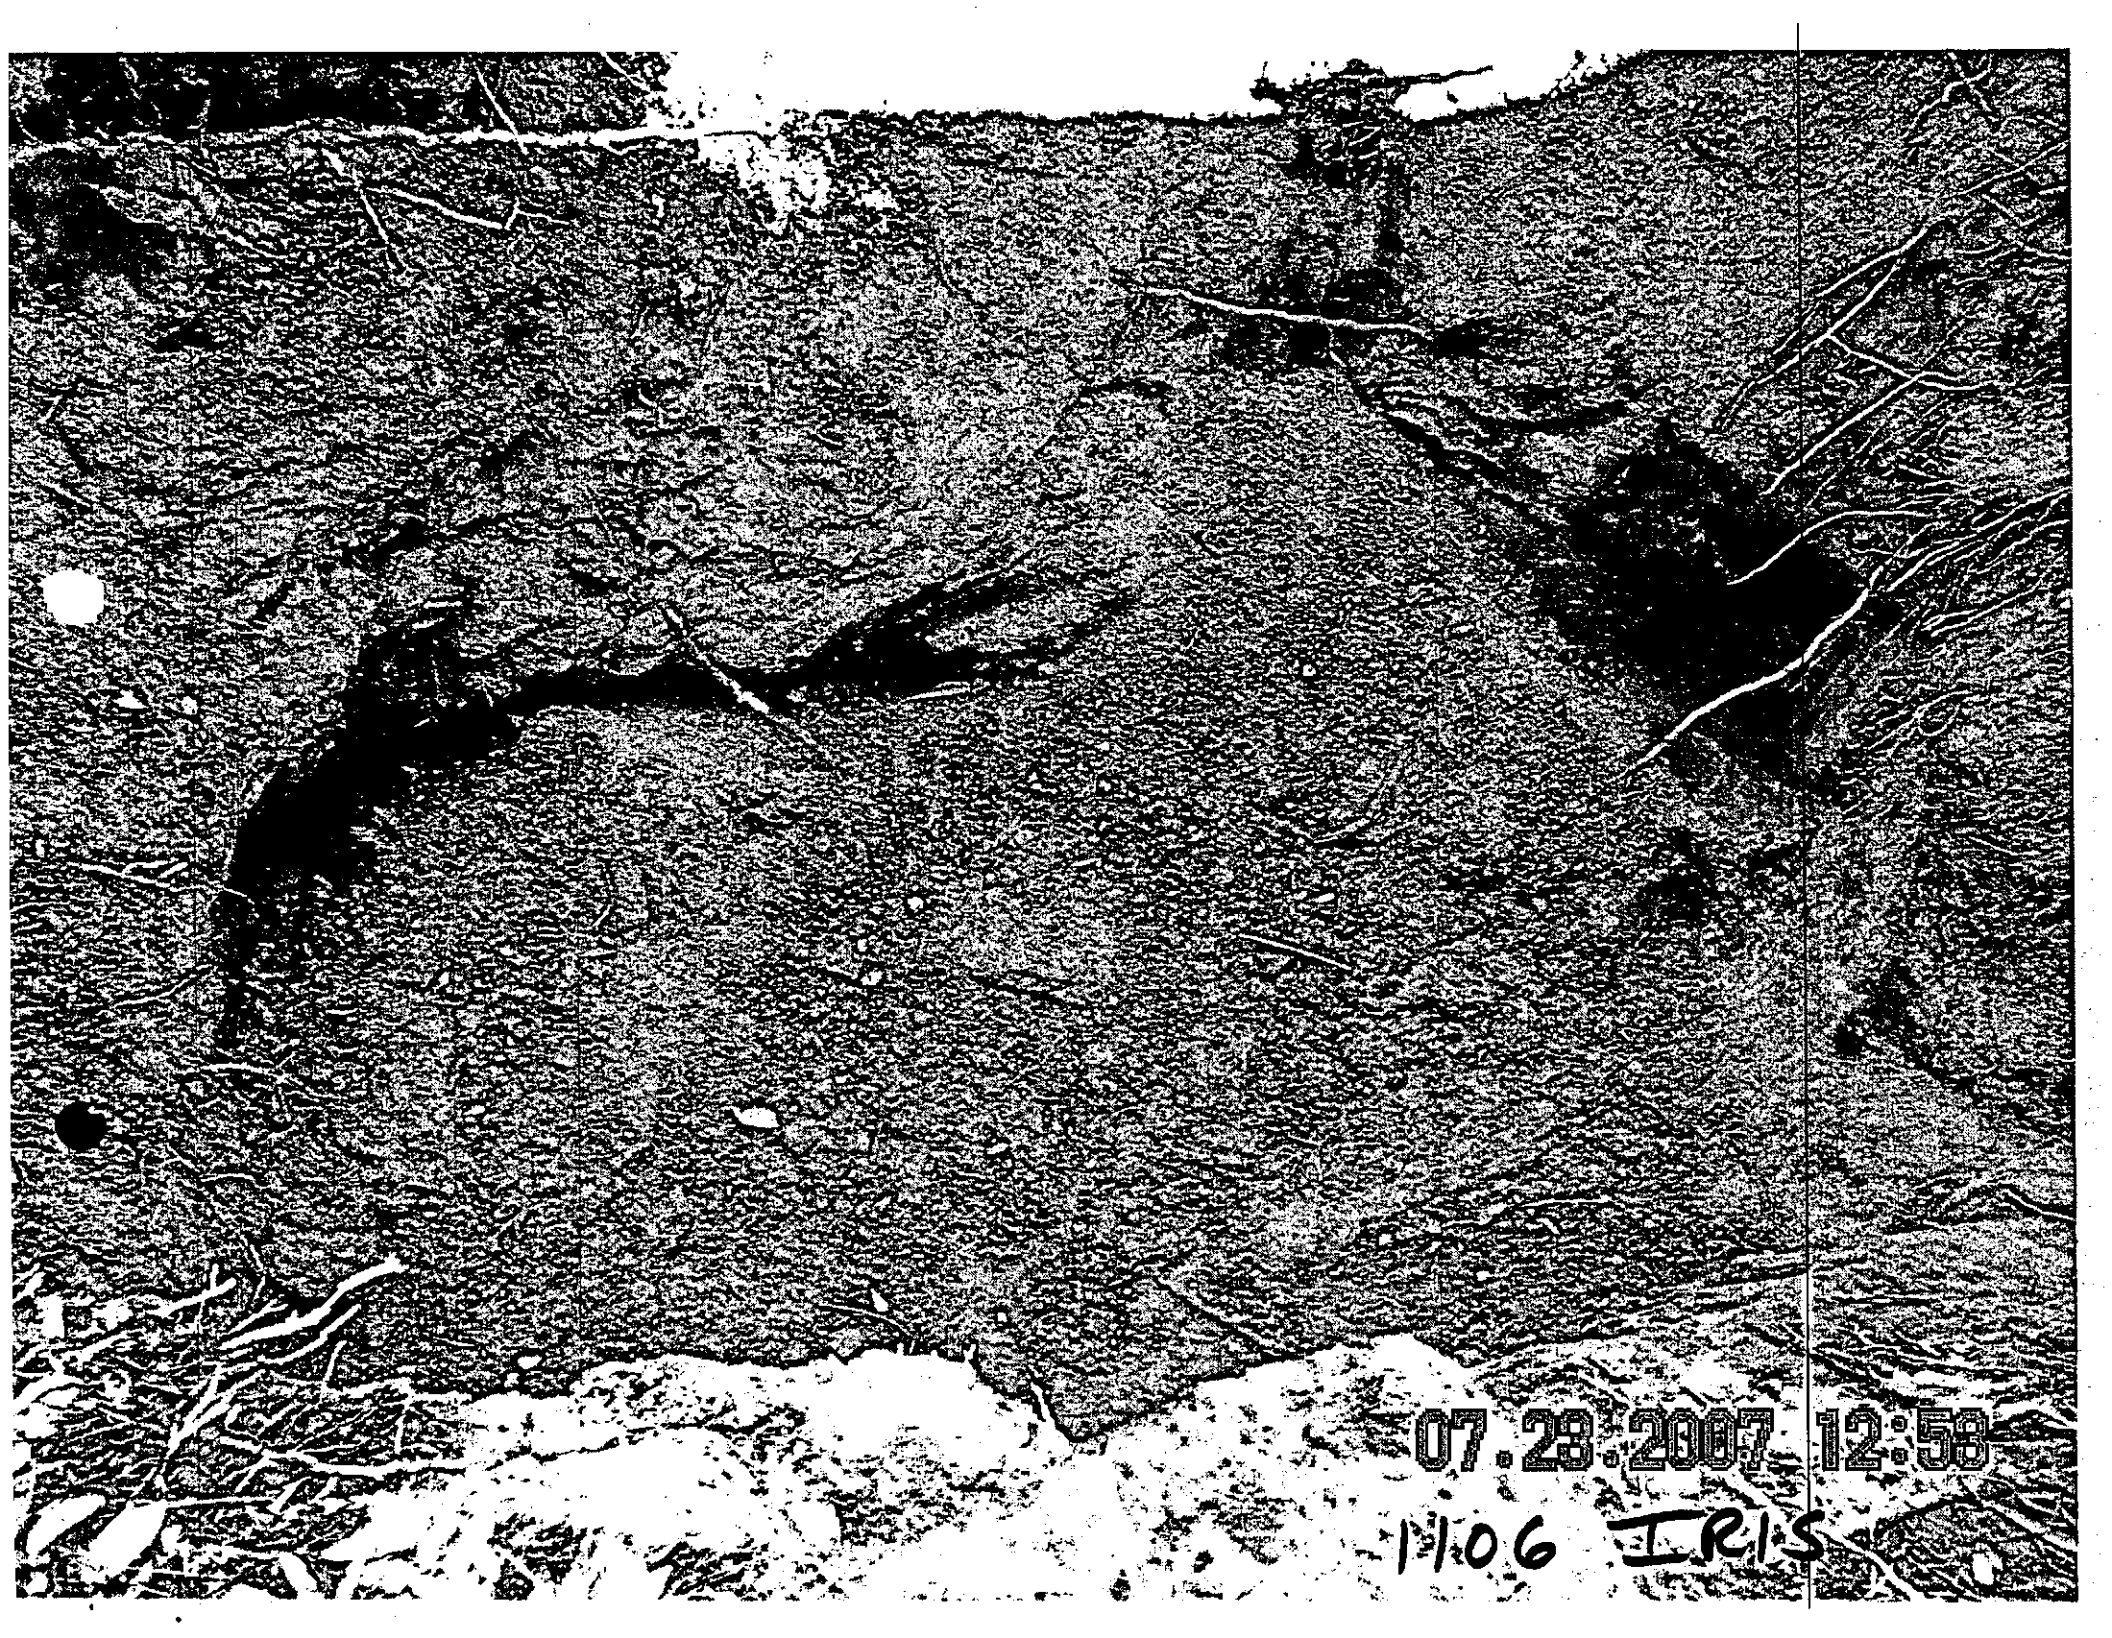

07.28.2007 12:58

1106 IRIS

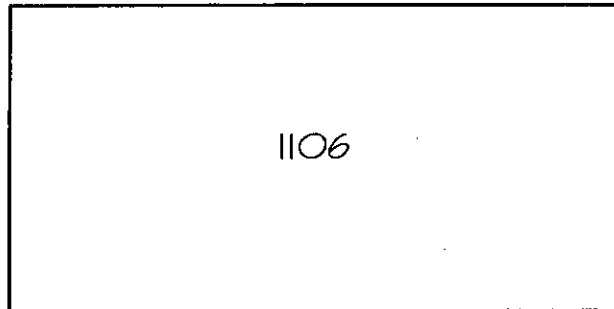

1106

A B

TANK I
BASE 66"

IRIS LANE

TANK I EXCAVATION

A-SOIL TEST SIDE SAMPLE @ 42"

B-SOIL TEST BOTTOM SAMPLE @ 66"



CUSTOMER:

BEAUFORT MILITARY COMPLEX FAMILY HOUSING

SITE ADDRESS:

1106 IRIS LANE

SCALE:

1/16"=1'-0"

SUPPLIER:

EPG INC.

DATE:

9/22/2007

EPG INC.

P.O. BOX 1096

MOUNT PLEASANT, SC 29465-1096

Appendix C
Laboratory Analytical Report - Groundwater

ANALYTICAL RESULTS

Project: LAUREL BAY SAMPLING 7/28/08
Pace Project No.: 9224472

Sample: 1100 IRIS A		Lab ID: 9224472019	Collected: 07/28/08 15:00		Received: 07/30/08 17:00		Matrix: Water	
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
8260 MSV Low Level		Analytical Method: EPA 8260						
Ethylbenzene	ND	ug/L	1.0	1		08/02/08 00:53	100-41-4	
Naphthalene	ND	ug/L	1.0	1		08/02/08 00:53	91-20-3	
Toluene	ND	ug/L	1.0	1		08/02/08 00:53	108-88-3	
m&p-Xylene	ND	ug/L	2.0	1		08/02/08 00:53	1330-20-7	
o-Xylene	ND	ug/L	1.0	1		08/02/08 00:53	95-47-6	
4-Bromofluorobenzene (S)	96 %		87-109	1		08/02/08 00:53	460-00-4	
Dibromofluoromethane (S)	98 %		85-115	1		08/02/08 00:53	1868-53-7	
1,2-Dichloroethane-d4 (S)	100 %		79-120	1		08/02/08 00:53	17060-07-0	
Toluene-d8 (S)	99 %		70-120	1		08/02/08 00:53	2037-26-5	

Sample: 1106 IRIS A		Lab ID: 9224472020	Collected: 07/28/08 15:20		Received: 07/30/08 17:00		Matrix: Water	
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
8270 MSSV PAH by SIM SPE		Analytical Method: EPA 8270 by SIM Preparation Method: EPA 3535						
Acenaphthene	ND	ug/L	2.0	1	08/03/08 00:00	08/12/08 17:34	83-32-9	
Acenaphthylene	ND	ug/L	1.5	1	08/03/08 00:00	08/12/08 17:34	208-96-8	
Anthracene	ND	ug/L	0.050	1	08/03/08 00:00	08/12/08 17:34	120-12-7	
Benzo(a)anthracene	ND	ug/L	0.10	1	08/03/08 00:00	08/12/08 17:34	56-55-3	
Benzo(a)pyrene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	50-32-8	
Benzo(b)fluoranthene	ND	ug/L	0.30	1	08/03/08 00:00	08/12/08 17:34	205-99-2	
Benzo(g,h,i)perylene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	191-24-2	
Benzo(k)fluoranthene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	207-08-9	
Chrysene	ND	ug/L	0.10	1	08/03/08 00:00	08/12/08 17:34	218-01-9	
Dibenz(a,h)anthracene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	53-70-3	
Fluoranthene	ND	ug/L	0.30	1	08/03/08 00:00	08/12/08 17:34	206-44-0	
Fluorene	ND	ug/L	0.31	1	08/03/08 00:00	08/12/08 17:34	86-73-7	
Indeno(1,2,3-cd)pyrene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	193-39-5	
1-Methylnaphthalene	ND	ug/L	2.0	1	08/03/08 00:00	08/12/08 17:34	90-12-0	
2-Methylnaphthalene	ND	ug/L	2.0	1	08/03/08 00:00	08/12/08 17:34	91-57-6	
Naphthalene	ND	ug/L	1.5	1	08/03/08 00:00	08/12/08 17:34	91-20-3	
Phenanthrene	ND	ug/L	0.20	1	08/03/08 00:00	08/12/08 17:34	85-01-8	
Pyrene	ND	ug/L	0.10	1	08/03/08 00:00	08/12/08 17:34	129-00-0	
Nitrobenzene-d5 (S)	50 %		50-150	1	08/03/08 00:00	08/12/08 17:34	4165-60-0	
2-Fluorobiphenyl (S)	60 %		50-150	1	08/03/08 00:00	08/12/08 17:34	321-60-8	
Terphenyl-d14 (S)	64 %		50-150	1	08/03/08 00:00	08/12/08 17:34	1718-51-0	

8260 MSV Low Level		Analytical Method: EPA 8260						
Benzene	ND	ug/L	1.0	1		08/02/08 01:16	71-43-2	
Ethylbenzene	ND	ug/L	1.0	1		08/02/08 01:16	100-41-4	
Naphthalene	ND	ug/L	1.0	1		08/02/08 01:16	91-20-3	
Toluene	ND	ug/L	1.0	1		08/02/08 01:16	108-88-3	
m&p-Xylene	ND	ug/L	2.0	1		08/02/08 01:16	1330-20-7	
o-Xylene	ND	ug/L	1.0	1		08/02/08 01:16	95-47-6	
4-Bromofluorobenzene (S)	97 %		87-109	1		08/02/08 01:16	460-00-4	

Date: 08/13/2008 05:36 PM

REPORT OF LABORATORY ANALYSIS

Page 21 of 38

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



ANALYTICAL RESULTS

Project: LAUREL BAY SAMPLING 7/28/08
Pace Project No.: 9224472

Sample: 1106 IRIS A		Lab ID: 9224472020	Collected: 07/28/08 15:20	Received: 07/30/08 17:00	Matrix: Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
8260 MSV Low Level		Analytical Method: EPA 8260						
Dibromofluoromethane (S)	96 %		85-115	1		08/02/08 01:16	1868-53-7	
1,2-Dichloroethane-d4 (S)	99 %		79-120	1		08/02/08 01:16	17060-07-0	
Toluene-d8 (S)	99 %		70-120	1		08/02/08 01:16	2037-26-5	

Sample: 1106 IRIS D		Lab ID: 9224472021	Collected: 07/28/08 15:25	Received: 07/30/08 17:00	Matrix: Water			
Parameters	Results	Units	Report Limit	DF	Prepared	Analyzed	CAS No.	Qual
8270 MSSV PAH by SIM SPE		Analytical Method: EPA 8270 by SIM Preparation Method: EPA 3535						
Acenaphthene	ND ug/L		2.0	1	08/03/08 00:00	08/12/08 17:58	83-32-9	
Acenaphthylene	ND ug/L		1.5	1	08/03/08 00:00	08/12/08 17:58	208-96-8	
Anthracene	ND ug/L		0.050	1	08/03/08 00:00	08/12/08 17:58	120-12-7	
Benzo(a)anthracene	ND ug/L		0.10	1	08/03/08 00:00	08/12/08 17:58	56-55-3	
Benzo(a)pyrene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	50-32-8	
Benzo(b)fluoranthene	ND ug/L		0.30	1	08/03/08 00:00	08/12/08 17:58	205-99-2	
Benzo(g,h,i)perylene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	191-24-2	
Benzo(k)fluoranthene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	207-08-9	
Chrysene	ND ug/L		0.10	1	08/03/08 00:00	08/12/08 17:58	218-01-9	
Dibenz(a,h)anthracene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	53-70-3	
Fluoranthene	ND ug/L		0.30	1	08/03/08 00:00	08/12/08 17:58	206-44-0	
Fluorene	ND ug/L		0.31	1	08/03/08 00:00	08/12/08 17:58	86-73-7	
Indeno(1,2,3-cd)pyrene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	193-39-5	
1-Methylnaphthalene	ND ug/L		2.0	1	08/03/08 00:00	08/12/08 17:58	90-12-0	
2-Methylnaphthalene	ND ug/L		2.0	1	08/03/08 00:00	08/12/08 17:58	91-57-6	
Naphthalene	ND ug/L		1.5	1	08/03/08 00:00	08/12/08 17:58	91-20-3	
Phenanthrene	ND ug/L		0.20	1	08/03/08 00:00	08/12/08 17:58	85-01-8	
Pyrene	ND ug/L		0.10	1	08/03/08 00:00	08/12/08 17:58	129-00-0	
Nitrobenzene-d5 (S)	57 %		50-150	1	08/03/08 00:00	08/12/08 17:58	4165-60-0	
2-Fluorobiphenyl (S)	54 %		50-150	1	08/03/08 00:00	08/12/08 17:58	321-60-8	
Terphenyl-d14 (S)	58 %		50-150	1	08/03/08 00:00	08/12/08 17:58	1718-51-0	

8260 MSV Low Level		Analytical Method: EPA 8260						
Benzene	ND ug/L		1.0	1		08/02/08 11:10	71-43-2	
Ethylbenzene	ND ug/L		1.0	1		08/02/08 11:10	100-41-4	
Naphthalene	ND ug/L		1.0	1		08/02/08 11:10	91-20-3	
Toluene	ND ug/L		1.0	1		08/02/08 11:10	108-88-3	
m&p-Xylene	ND ug/L		2.0	1		08/02/08 11:10	1330-20-7	
o-Xylene	ND ug/L		1.0	1		08/02/08 11:10	95-47-6	
4-Bromofluorobenzene (S)	94 %		87-109	1		08/02/08 11:10	460-00-4	
Dibromofluoromethane (S)	97 %		85-115	1		08/02/08 11:10	1868-53-7	
1,2-Dichloroethane-d4 (S)	103 %		79-120	1		08/02/08 11:10	17060-07-0	
Toluene-d8 (S)	99 %		70-120	1		08/02/08 11:10	2037-26-5	

Date: 08/13/2008 05:36 PM

REPORT OF LABORATORY ANALYSIS

Page 22 of 38

This report shall not be reproduced, except in full,
without the written consent of Pace Analytical Services, Inc..



Appendix D

Regulatory Correspondence

BOARD:
Paul C. Aughtry, III
Chairman
Edwin H. Cooper, III
Vice Chairman
Steven G. Kisner
Secretary



C. Earl Hunter, Commissioner

Promoting and protecting the health of the public and the environment

BOARD:
Henry C. Scott
M. David Mitchell, MD
Glenn A. McCall
Coleman F. Buckhouse, MD

13 August 2008

Beaufort Military Complex Family Housing
ATTN: Kyle Broadfoot
1510 Laurel Bay Blvd.
Beaufort, SC 29906

Re: MCAS – Laurel Bay Housing – 1106 Iris
Site ID # 03981
UST Closure Reports received 31 January 2008
Beaufort County

Dear Mr. Broadfoot:

The purpose of this letter is to verify a release of fuel oil at the referenced residence. According to information received by the Department, the source of the release is from past onsite use of fuel oil USTs. To date, initial activities by the facility have included tank removal and soil sampling. Based on the information contained in the closure report, a potential violation of the South Carolina Pollution Control Act has occurred in that there has been an unauthorized release of petroleum to the environment.

Additional assessment activities are required for this site. Specifically the Department requests that a groundwater sample be collected from this site. Please note, the Department approved a groundwater sampling proposal for Laurel Bay submitted by MCAS under separate cover dated 16 June 2008.

Should you have any questions, please contact me at 803-898-3553 (office phone), 803-898-2893 (fax) or bishopma@dhec.sc.gov.

Sincerely,

Michael Bishop, Hydrogeologist
Groundwater Quality Section
Bureau of Water

cc: Region 8 District EQC (via pdf)
MCAS, Commanding Officer, Attention: S-4 NREAO (William Drawdy) (via pdf)
Technical File



C. Earl Hunter, Commissioner

Promoting and protecting the health of the public and the environment.

18 December 2008

Commanding Officer
ATTN: S-4 NREAO (Craig Ehde)
MCAS
PO Box 55001
Beaufort, SC 29904-5001

Re: MCAS – Laurel Bay Housing – 1106 Iris
Site ID # 03981
Groundwater Sampling Results received 6 November 2008
Beaufort County

Dear Mr. Ehde:

Per the Department's request, a groundwater sample was collected from the referenced site. The groundwater results were reported as non-detect. Based on the information and analytical data submitted, the Department recognizes that MCAS has adequately addressed the known environmental contamination identified on the property to date in accordance with the approved scope of work. Consequently, no further investigation is required at this time. Please note, this statement pertains only to the portion of the site addressed in the referenced report and does not apply to other areas of the site and/or any other potential regulatory violations. Further, the Department retains the right to request further investigation if deemed necessary.

Should you have any questions, please contact me at 803-896-4179 (office phone), 803-896-6245 (fax) or cookejt@dhec.sc.gov.

Sincerely,
AST Petroleum Restoration
& Site Environmental Investigations Section
Land Revitalization Division
Bureau of Land and Waste Management
SC Dept. of Health & Environmental Control

Jan T. Cooke, Hydrogeologist

B. Thomas Knight, Manager

cc: Region 8 District EQC
Tri-Command Communities; Attn: Mr. Robert Bible; 600 Laurel Bay Road Beaufort, SC
29906
Technical File